



SECTION A-A

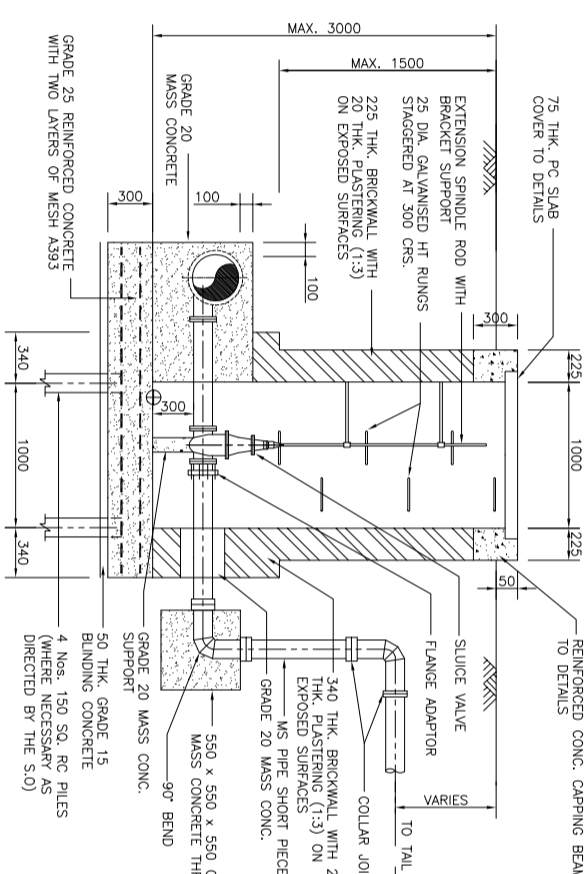


SECTION B-B

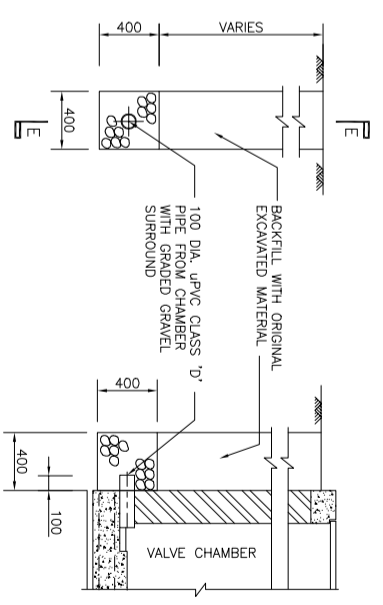

SECTIONAL ELEVATION


DETAIL OF SOAKAWAY PIT

SCALE A

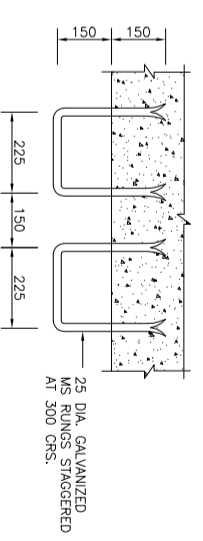

DETAIL OF STAGGERED GALVANIZED STEP-IRON


SCALE B

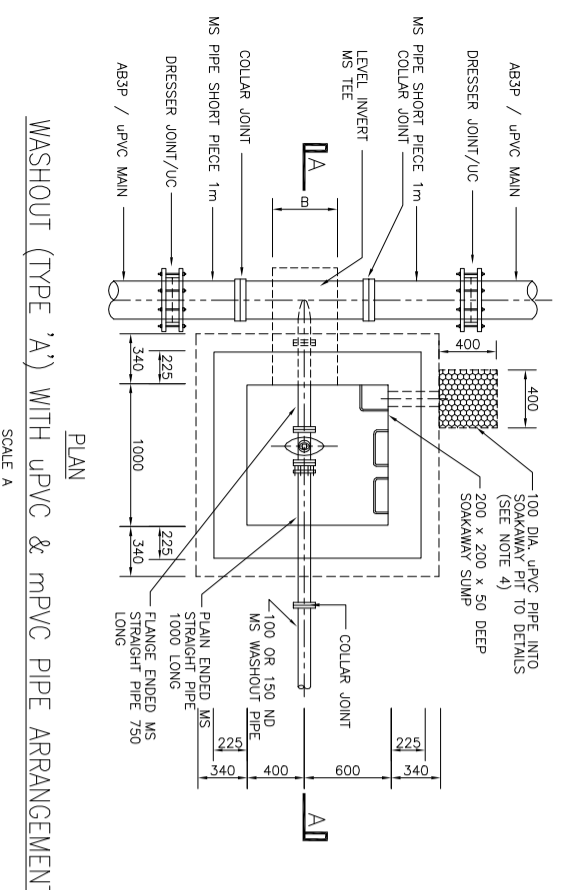

PLAN

SCALE A

WASHOUT (TYPE 'A') WITH uPVC & mPVC PIPE ARRANGEMENT

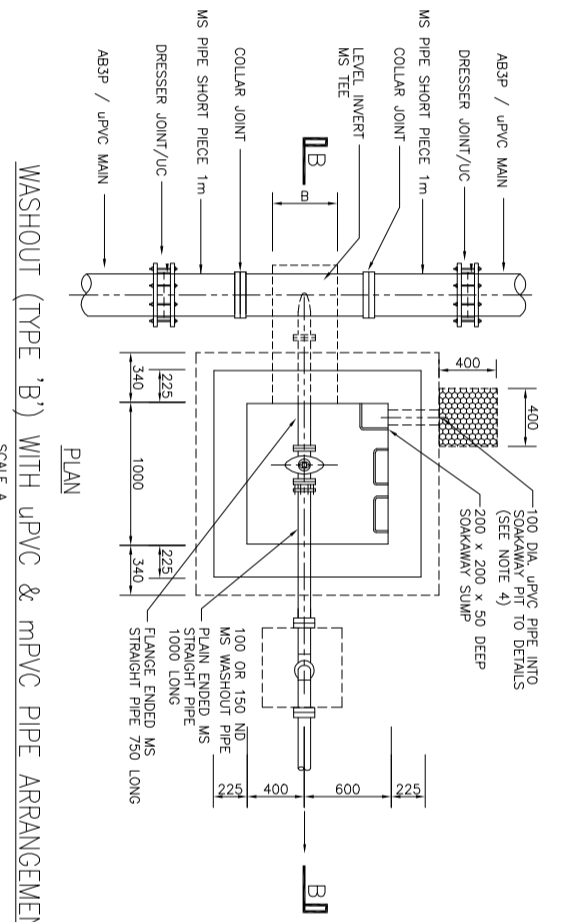

PLAN

SCALE A

WASHOUT (TYPE 'B') WITH uPVC & mPVC PIPE ARRANGEMENT

WASHOUT SCHEDULE			
TYPE	MAIN PIPE DIA. (mm)	WASHOUT TEE BRANCH DIA. (mm)	WASHOUT TEE BRANCH DIA. (mm)
A AND B	100 - 400	100	150

THRUST BLOCK FOR WASHOUT TEE (CHAMBER TYPE 'A' AND TYPE 'B')			
BRANCH PIPE NO	(mm)	(mm)	(mm)
150		450	
100		400	

- NOTE:
- 1) ALL DIMENSIONS ARE IN MILLIMETRE AND LEVELS IN METRE UNLESS OTHERWISE STATED.
 - 2) ALL CONCRETE TO BE GRADE 25 UNLESS OTHERWISE STATED.
 - 3) ALL GRAVEL SOAKAWAY TO BE WASHED WITH TWO LAYERS OF APPROVED FILTER CLOTH.
 - 4) THE uPVC DRAIN PIPE AND SOAKAWAY SHALL ONLY BE PROVIDED IF THE GROUND WATER TABLE IS LOWER THAN THE INVERT LEVEL OF THE CHAMBER AS INDICATED BY THE S.O.
 - 5) FOR DETAILS OF PC SLAB COVER AND CAPPING BEAM REFER DRG. NO. SA/JSTD/CH/01

REV.	REVISION BY	DESCRIPTION	DATE



SAJ Holdings Sdn Bhd. (476718-H)
 Jalan Garuda, Larkin, P.O Box 262,
 80350 Johor Bahru, Johor, Malaysia
 T: +607 - 224 4040 F: +607 - 224 0033

PROJECT: 1800-86-7124 s/n 019/712/7174 www.saj.com.my customer care@saj.com.my

DRAWING TITLE:
 DETAILS OF BRICK WALL WASHOUT CHAMBER WITH uPVC & mPVC PIPE ARRANGEMENT

DRAWN BY: MAZZ DESIGNED: WJC
 CHECKED: MFB APPROVED: TJC
 SCALE: NOT TO SCALE DATE: DECEMBER 2013
 DRAWING NO: SA/JSTD/CH/09